


# Headquarters of Fortune 100 Company Cooling Towers and Chillers

Updated on July 15, 2019



# Key Success Factors

- **Reduction of scale and biofouling accumulation in the cooling towers and chillers.**
- **At least 50% conservation of blow-down water.**
- **Chemical reduction and optimization.**
- **Increased life-cycle of equipment, fill material and piping.**
- **Reduction in energy costs.**
- **Reduction in maintenance costs.**

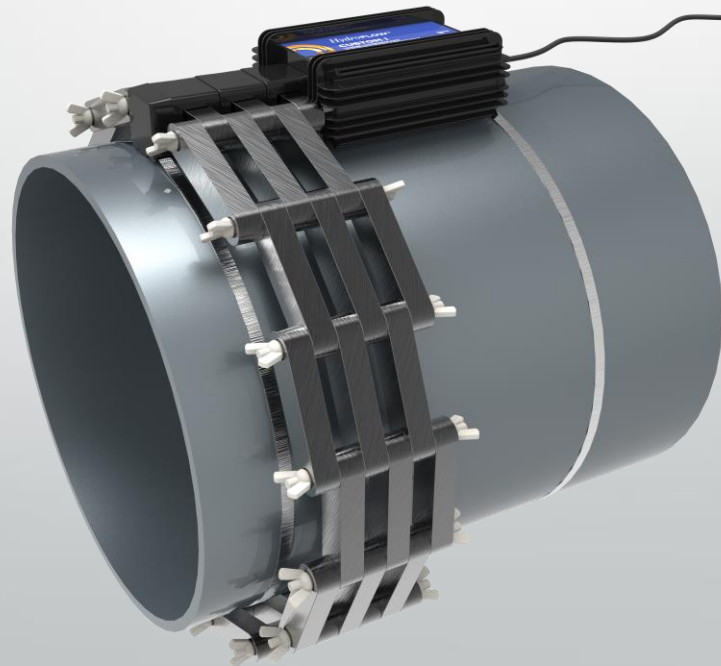

# Results

**“HydroFLOW significantly improved the operation of our cooling system, in terms of cost and maintenance. This technology pays for itself with the monthly savings it attains.”**

*Quote from the Facilities Manager*

- **85% blow-down water reduction, which greatly exceeded the 50% goal.**
- **75% chemical reduction.**
- **50% reduction in maintenance frequency.**
- **10% reduction in energy consumption by the cooling towers and chillers.**

**Annual water and energy savings were \$73,400**

(A detailed report is available upon request)